

(1) Number of pages \_\_\_\_\_

(2) Date of repair \_\_\_\_\_

(3) Initials of the Referencer \_\_\_\_\_

## MADRAS RECORD OFFICE.

Government of Madras.

*Public works* DEPARTMENT.

|                 |        |
|-----------------|--------|
| G.O. No. 3263   | Press  |
|                 | Mis. - |
| 746-747         |        |
| Dated 30 - 10 - | 1865.  |

Not to be folded or roughly handled

*Proceedings of the Madras Government, Public Works Department,  
30th October 1865.*

No. 746. Read the following letter from the Superintending Engineer, 5th Division, to the Secretary to Government, Public Works Department, dated Bangalore, 25th October 1865, No. 8:—

In continuation of my letter of the 28th September 1865, No. 1,707, I have the honor to state that I do not think any danger is to be apprehended from the copper ventilator in the standard design for a Magazine, as it is connected with the conductor and the copper sheets which go down each corner of the building to the ground. But to remove even the appearance of danger, for the copper ventilator might be substituted one of brick work or earthenware, and no increase of expense will be incurred. One Magazine with a copper ventilator has already been built at the new Barracks, and if this alteration is approved, it can be made at once before the Magazine is used.

No. 747. ORDER THEREON, 30th October 1865, No. 3,263.

MILITARY WORKS, No. 41.

Recorded, with reference to the orders noted in the margin.

No. 3,164, 23rd October 1865.

(True Extract.)

(Signed) CHARLES A. ORR, Colonel, R. E.,  
*Secretary to Government.*

To the Superintending Engineer of the 5th Division.

Exd. S. T. Augustin.

39  
31 65  
no 3263

Recorded, with re-  
-ference to the orders noted  
in the margin -

164  
et/65


Stuart St George &  
30th Octo 1865

W.B.

The Supg Engineer  
of the 5th Dr

X<sup>o</sup> 87

31 October

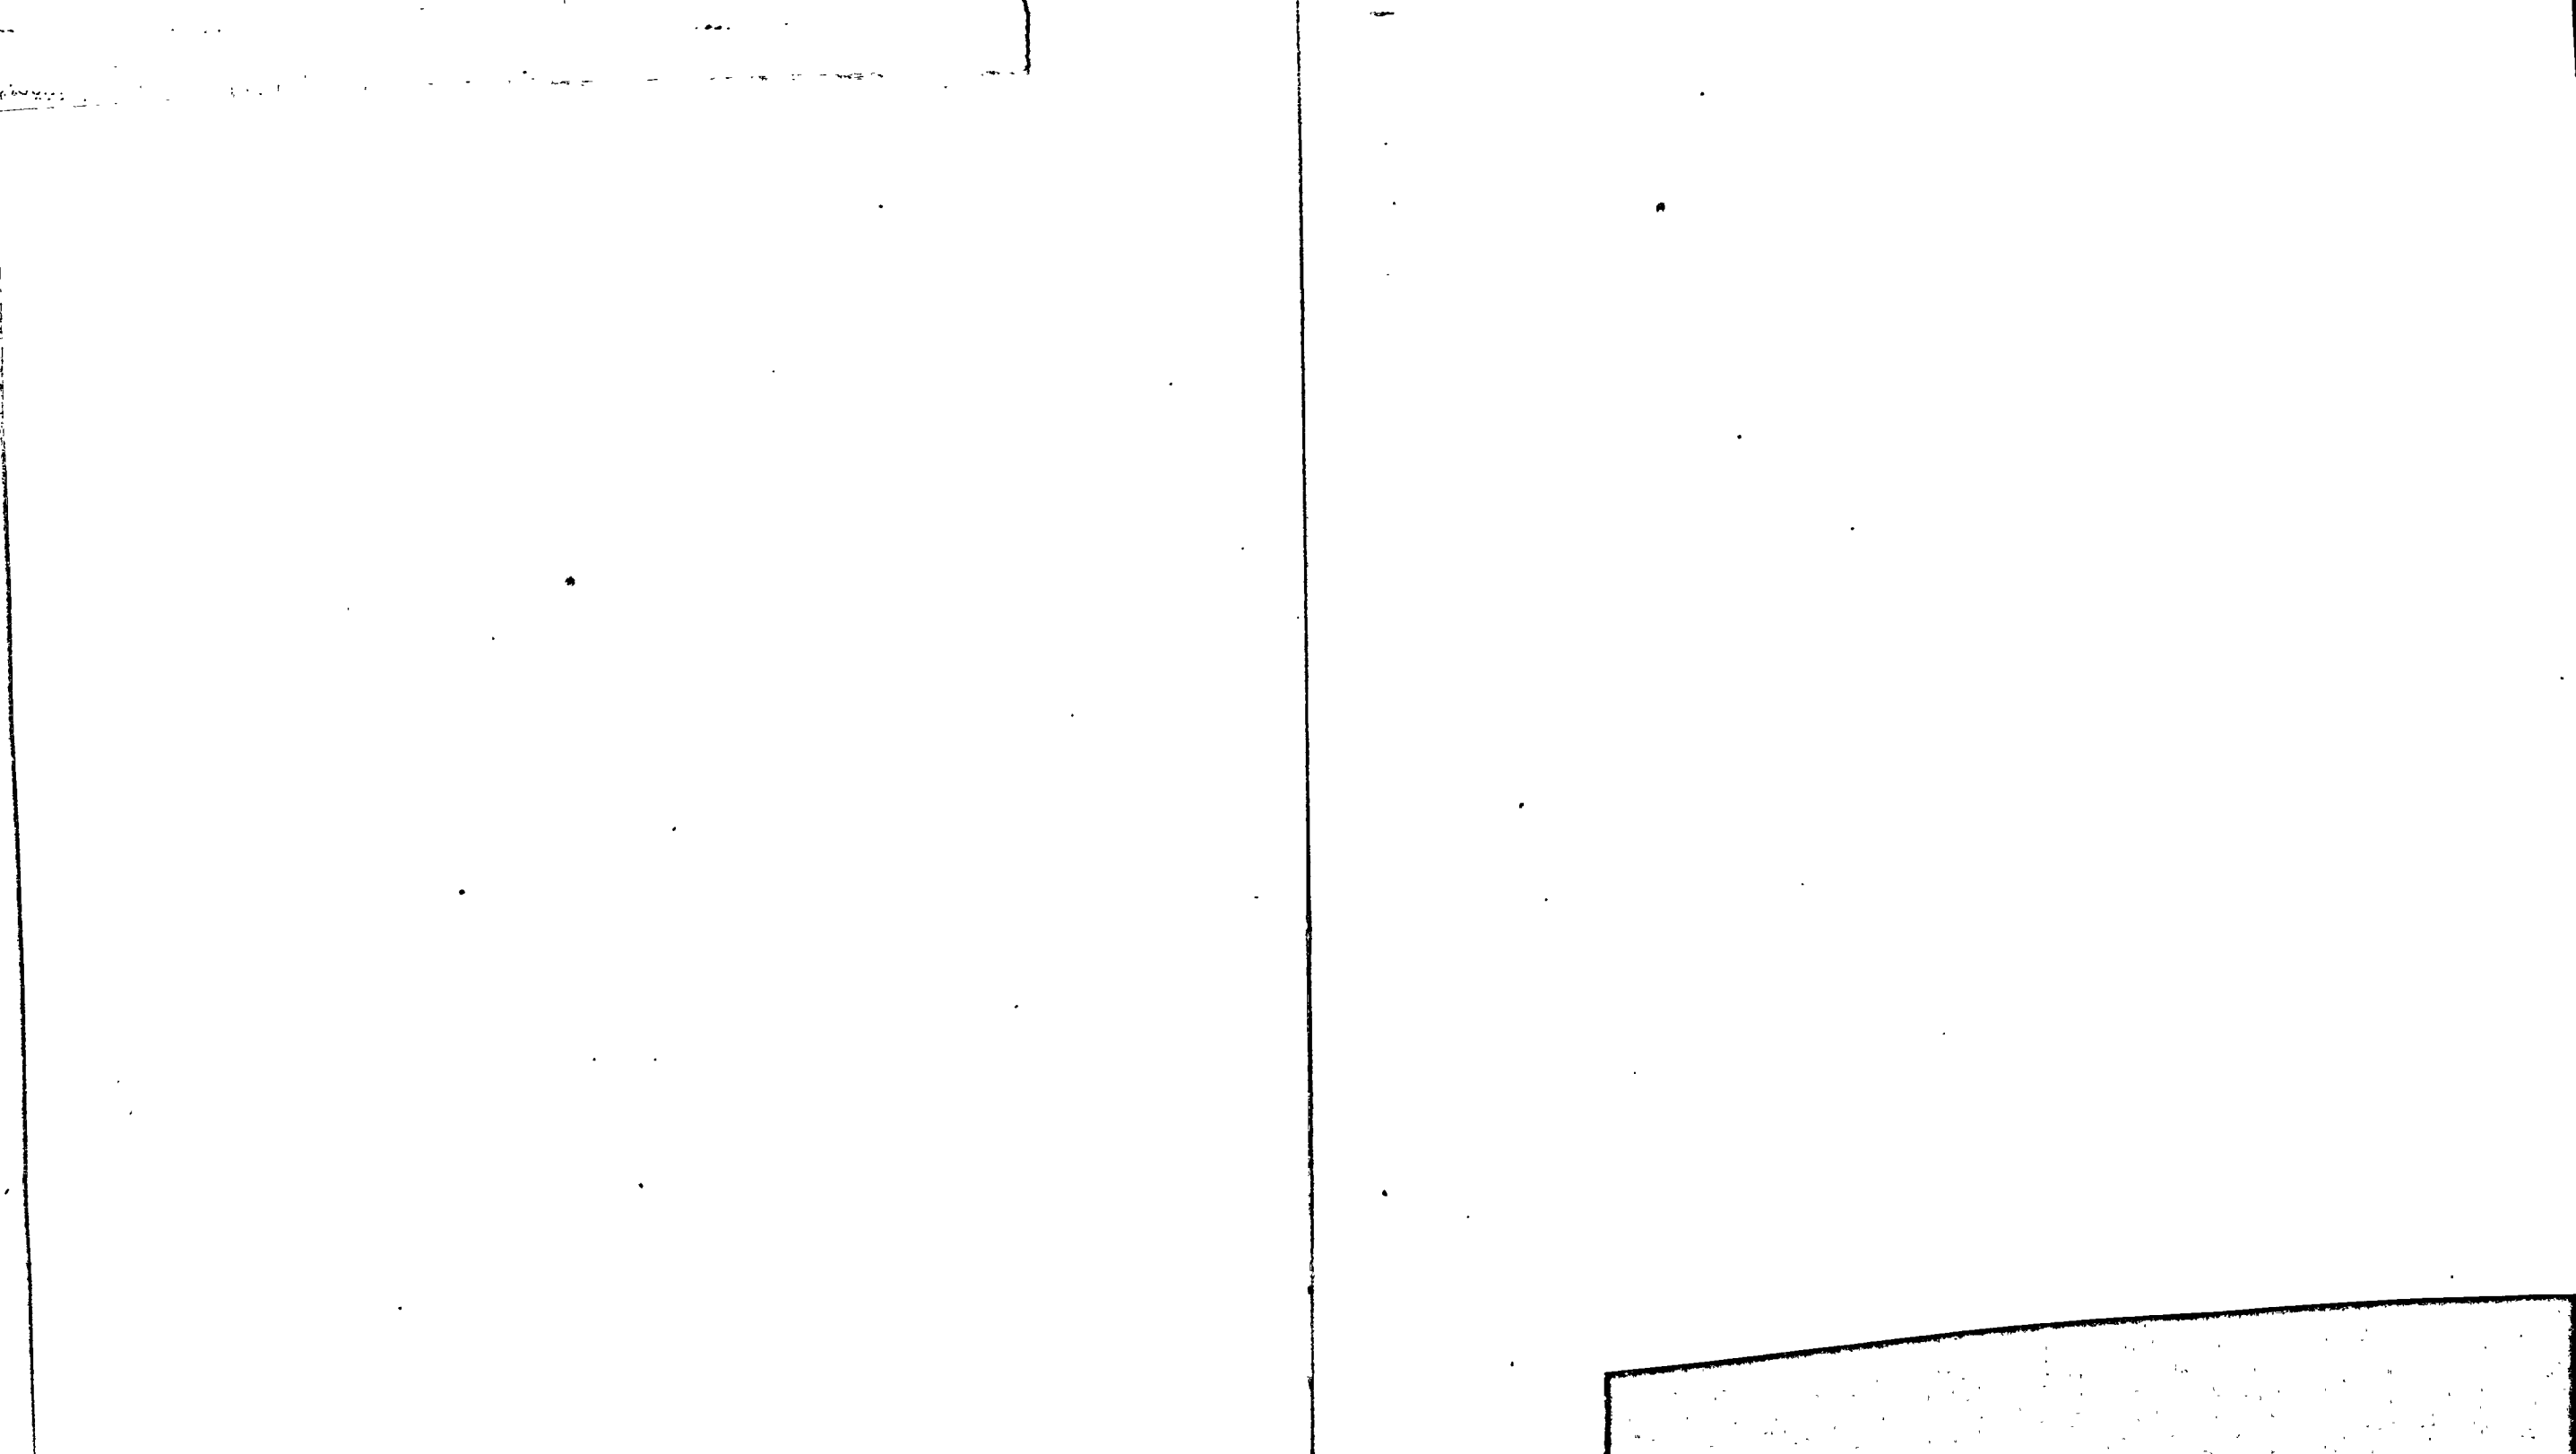

To V 1865 Depa  
Pro. of Genl for October  
From No 4198  
The Superintg Engineer  
5<sup>th</sup> Division

To The Secretary to Govern-  
ment S. W. D.

Dated 25<sup>th</sup> } October 1865.  
Recd. 26 }

No 8.

Recommending a brick  
work or Earthen ventilator  
for the Magazine,  
instead of one of Copper.

With an order.

ev 3263. 30<sup>th</sup> Octo 1865

No 746. 747